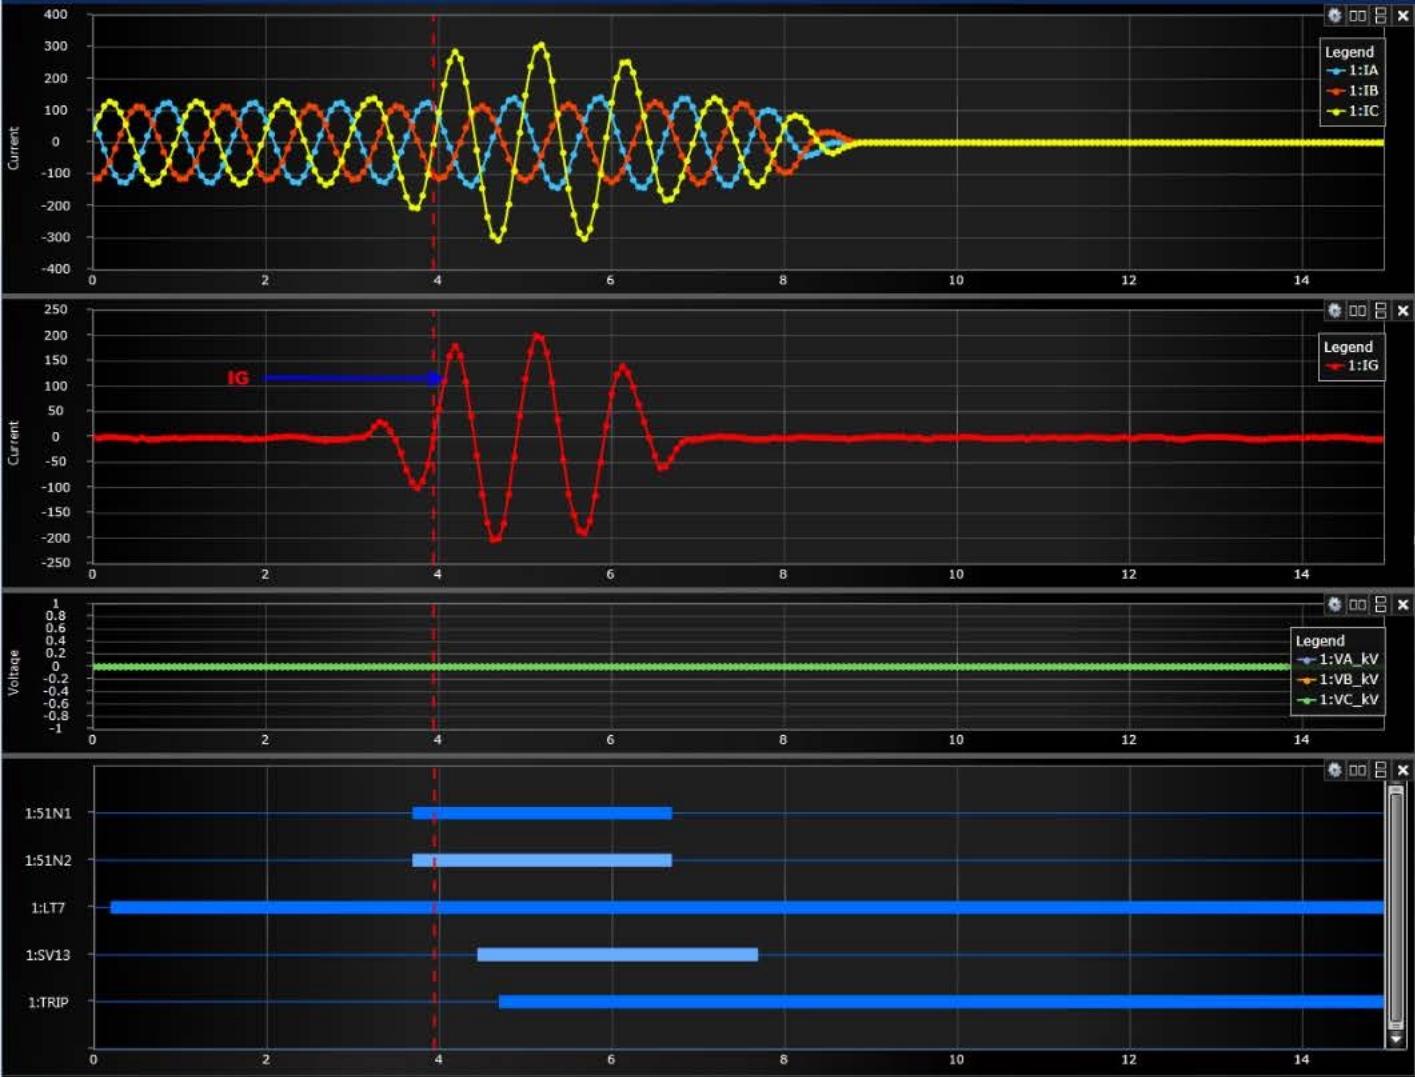

Events

Load Event

1 relay
7/19/2011 1:31:40.963000 PM

File: Case5.cev
FID=SEL-351R-2-R308-V0-Z007006-D20110303
Event: CG T
Fault Location: $$$$$$$
Frequency: 60 Hz Sample Rate: 16 Samples/Cycle
Targets: 11001100 01000110

Relay Settings | Adjust Time | Export Event (Comtrade)

Custom Calculations

default

Export Data (CSV) | Screenshot | Print